


DETAIL 02713-8
COBB COUNTY WATER SYSTEM
WATER LINE VALVING AT INTERSECTION

JANUARY 23, 2002

AGENCY DIRECTOR

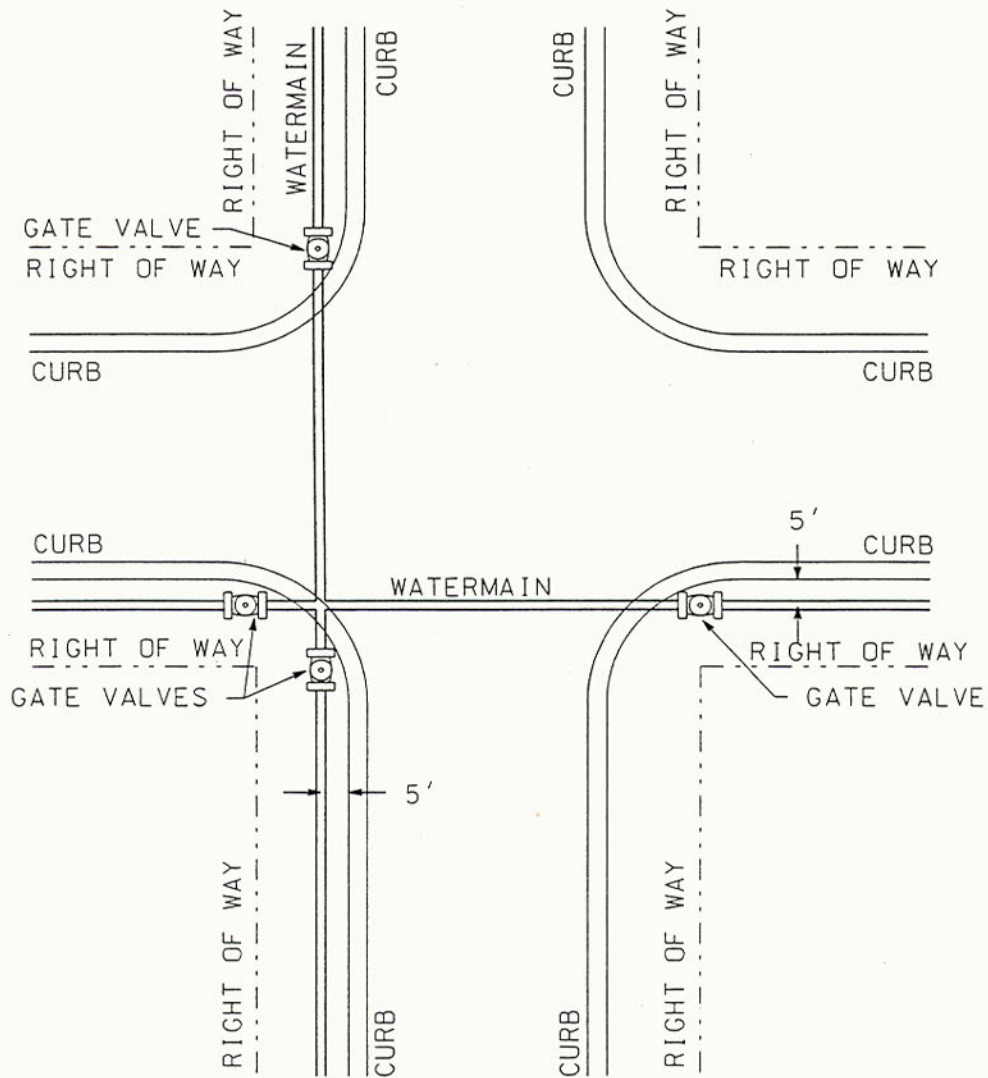

1. VALVES ARE TO BE LOCATED
5'-0" BEHIND THE CURB IN
THE RIGHT OF WAY
2. VALVES SHALL NOT BE LOCATED
IN THE DITCH LINE